



KING STREET WATER TREATMENT PLANT
2025 ANNUAL REPORT

Drinking Water System Number: 220001860
Drinking Water System Owner: City of Kingston
Drinking Water System Category: Large Municipal Residential

TABLE OF CONTENTS

1 EXECUTIVE SUMMARY..... 4

2 PLANT DESCRIPTION AND TREATMENT PROCESS 4

2.1 RAW WATER SOURCE..... 4

2.2 ZEBRA MUSSEL CONTROL..... 4

2.3 PRE-CHLORINATION 4

2.4 SCREENING..... 4

2.5 LOW LIFT PUMPS 4

2.6 COAGULATION / FLOCCULATION..... 4

2.7 MIXING TANKS..... 5

2.8 SETTLING TANKS 5

2.9 FILTERS 5

2.10 BACKWASH..... 5

2.11 PROCESS WASTE FACILITY..... 5

2.12 POST CHLORINATION 5

2.13 CLEAR WELL..... 5

2.14 HIGH LIFT PUMPS..... 5

2.15 STANDBY EQUIPMENT 5

Figure 1 – King Street Water Treatment Plant Process Flow Diagram 6

Figure 2 – Kingston Distribution System Process Flow Diagram 7

3 DISTRIBUTION SYSTEM 8

3.1 DISTRIBUTION AREA 1 8

3.2 DISTRIBUTION AREA 2 8

3.3 DISTRIBUTION AREA 3 8

4 MONETARY EXPENSES..... 8

4.1 MAJOR EXPENSES: 8

5 NOTIFICATIONS..... 9

5.1 EVENTS REQUIRING NOTIFICATIONS: 9

6 GLOSSARY 10

7 WATER QUALITY TEST RESULTS 11

Table 1 - Microbiological Testing 11

Table 2 - Operational Testing..... 11

Table 3 - Filter Operational Testing 11

Table 4 - Process Waste Facility Effluent Testing and Sampling 12

Table 5 - Additional Process Waste Facility Effluent Testing and Sampling 12

Table 6 - Raw Water Testing 12

Table 7 - Treated Water Schedule 23 Inorganic Parameters 14

Table 8 - Treated Water Schedule 24 Inorganic Parameters 14

Table 9 - Other Regulatory Treated Water Parameters 16

Table 10 - Treated Water Testing 17

Table 11 - Regulatory Distribution Water Testing 18

Table 12 - Lead Testing 18

DOCUMENT:

King Street Water Treatment Plant Annual Report

Table 13 - Distribution Water Testing 19
Table 14 - Raw Water Testing 20
Table 15 - Treated Water Testing 21

1 EXECUTIVE SUMMARY

Utilities Kingston is proud to present this annual report on drinking water quality. This report has been prepared in accordance with Section 11 of Ontario Regulation 170/03. Regulation 170/03 sets requirements for public waterworks with regard to sampling and testing, levels of treatment, licensing of staff, and notification of authorities and the public about water quality. Free copies of this report and the Summary report prepared in accordance to Schedule 22 of Ontario Regulation 170/03, are available by public request at any City of Kingston offices, at our water plant locations, and at <http://www.utilitieskingston.com>. Notices of availability are generally made through social media and the Utilities Kingston website. More information on the Drinking Water Regulations can be found on the [Ministry of the Environment, Conservation and Parks](#) (MECP) website. For further information about this report or any questions regarding accessibility, contact Robert Cooney with email at rcooney@utilitieskingston.com, or call 613-546-1181 Ext 2291.

2 PLANT DESCRIPTION AND TREATMENT PROCESS

2.1 RAW WATER SOURCE

The source of water treated by this plant is Lake Ontario at the mouth of the St. Lawrence River. The intake is located 1km directly south of the treatment plant, 4m off the lake bottom, at a depth of approximately 18m. A great deal of testing was carried out in choosing the location for the intake. This has ensured that the treatment process begins by using the best and most consistent quality source water available and reduces its susceptibility to contamination. Known sources of potential problems are few, and response plans are in place in the event of raw water contamination.

2.2 ZEBRA MUSSEL CONTROL

When the water temperature rises above 10°C (above this temperature zebra mussels are active), pre-chlorination takes place at the mouth of the intake. This protects the intake from becoming encrusted with zebra mussels, which would restrict the flow of water through the intake.

2.3 PRE-CHLORINATION

The purpose of chlorination is to provide disinfection. 12% Sodium Hypochlorite is applied to the raw water in solution form.

2.4 SCREENING

A revolving screen in the suction well of the low lift building removes any large debris such as weeds, fish, etc.

2.5 LOW LIFT PUMPS

These pumps lift the water from lake level to the main plant. There are two pipes from the low lift building directing the water to the mixing chambers.

2.6 COAGULATION / FLOCCULATION

Poly Aluminum Chloride (PACl) is used as the coagulant for the treatment process. The coagulant is added to the water as it leaves the low lift building.

2.7 MIXING TANKS

Water flows rapidly in these tanks in a spiral motion, allowing proper mixing of the chlorine and alum with the water. The particles in the water will collide with the PACl particles, and then join together to form larger particles called floc.

2.8 SETTLING TANKS

These are large tanks designed to reduce the velocity of water allowing the heavier floc particles to settle out. They also provide detention time, allowing the chlorine time to achieve disinfection.

2.9 FILTERS

Six rapid sand filters with Granular Activated Carbon (GAC) and anthracite remove the particles that did not settle out in the settling tanks, as well as compounds that may cause tastes and odours. Water flows through the filters to a clean water reservoir called the clear well.

2.10 BACKWASH

Filters are washed daily to remove the particulates they have collected over the previous 24 hrs. Clean water from the clear well is pumped backwards through the filter, and the top layer of the filter is agitated to break up any large particles. Effluent water from the backwash process is directed to a process waste facility for further treatment.

2.11 PROCESS WASTE FACILITY

Effluent from the filter backwash process and sludge from the settling process are directed to the process waste facility for further treatment. Effluent is directed to two equalization tanks at the head of the process. When needed, Magnafloc 120L can be added to the water as it is pumped from the equalization tanks through plate settlers at which time the supernatant from the process is de-chlorinated using a 30% Calcium Thiosulphate solution, and then directed back to Lake Ontario. The sludge produced during the process is then pumped to the sanitary sewer system for further treatment at the Ravensview Water Pollution Control Plant.

2.12 POST CHLORINATION

Sodium hypochlorite is added to the water as it enters the clear well to create a 'chlorine residual' which remains throughout the distribution system. This ensures protection to the point of the customers' tap.

2.13 CLEAR WELL

Filtered water is stored here before being pumped to the distribution system or used for filter washing.

2.14 HIGH LIFT PUMPS

Five high lift pumps move treated water from the clear well into the distribution system.

2.15 STANDBY EQUIPMENT

Diesel driven pumps are maintained to provide a continuous supply of water during power failures. These provide enough capacity to meet fire-fighting requirements as well as normal flows during power outages. A diesel generator provides electricity to run metering equipment and lighting in the water plant. Standby equipment is maintained for all critical processes.

Figure 1 – King Street Water Treatment Plant Process Flow Diagram


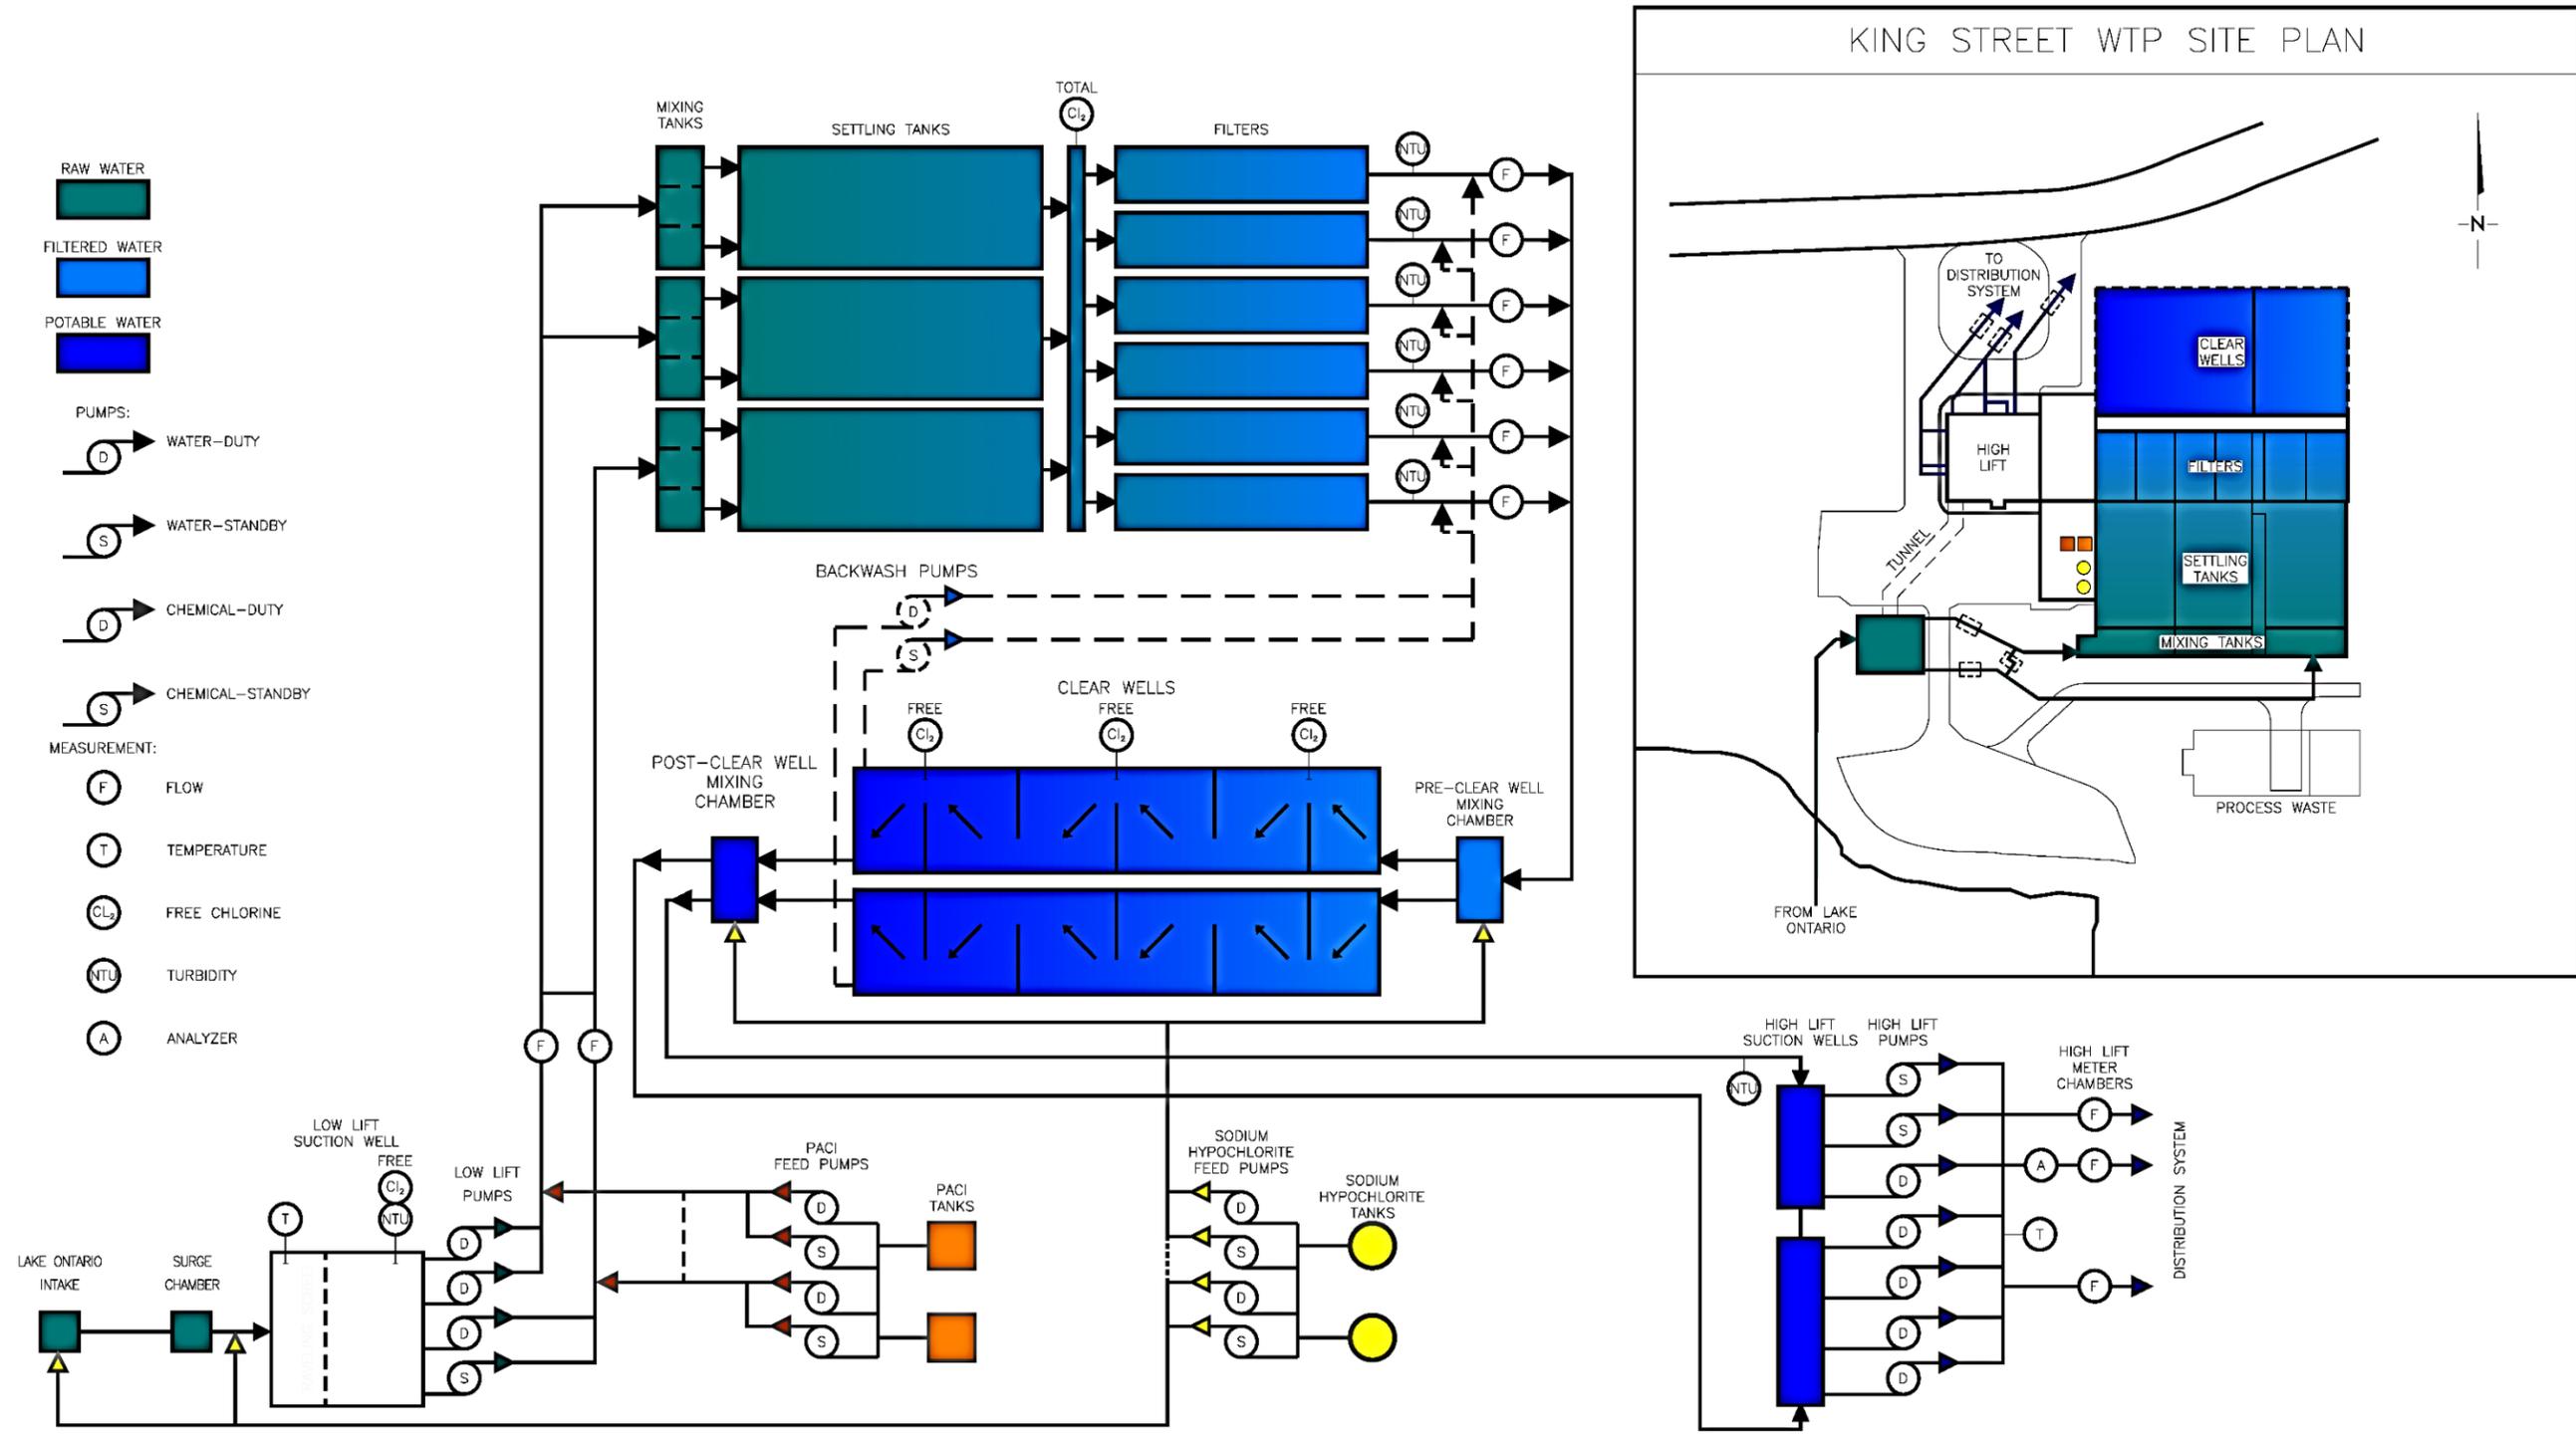


Figure 2 – Kingston Distribution System Process Flow Diagram

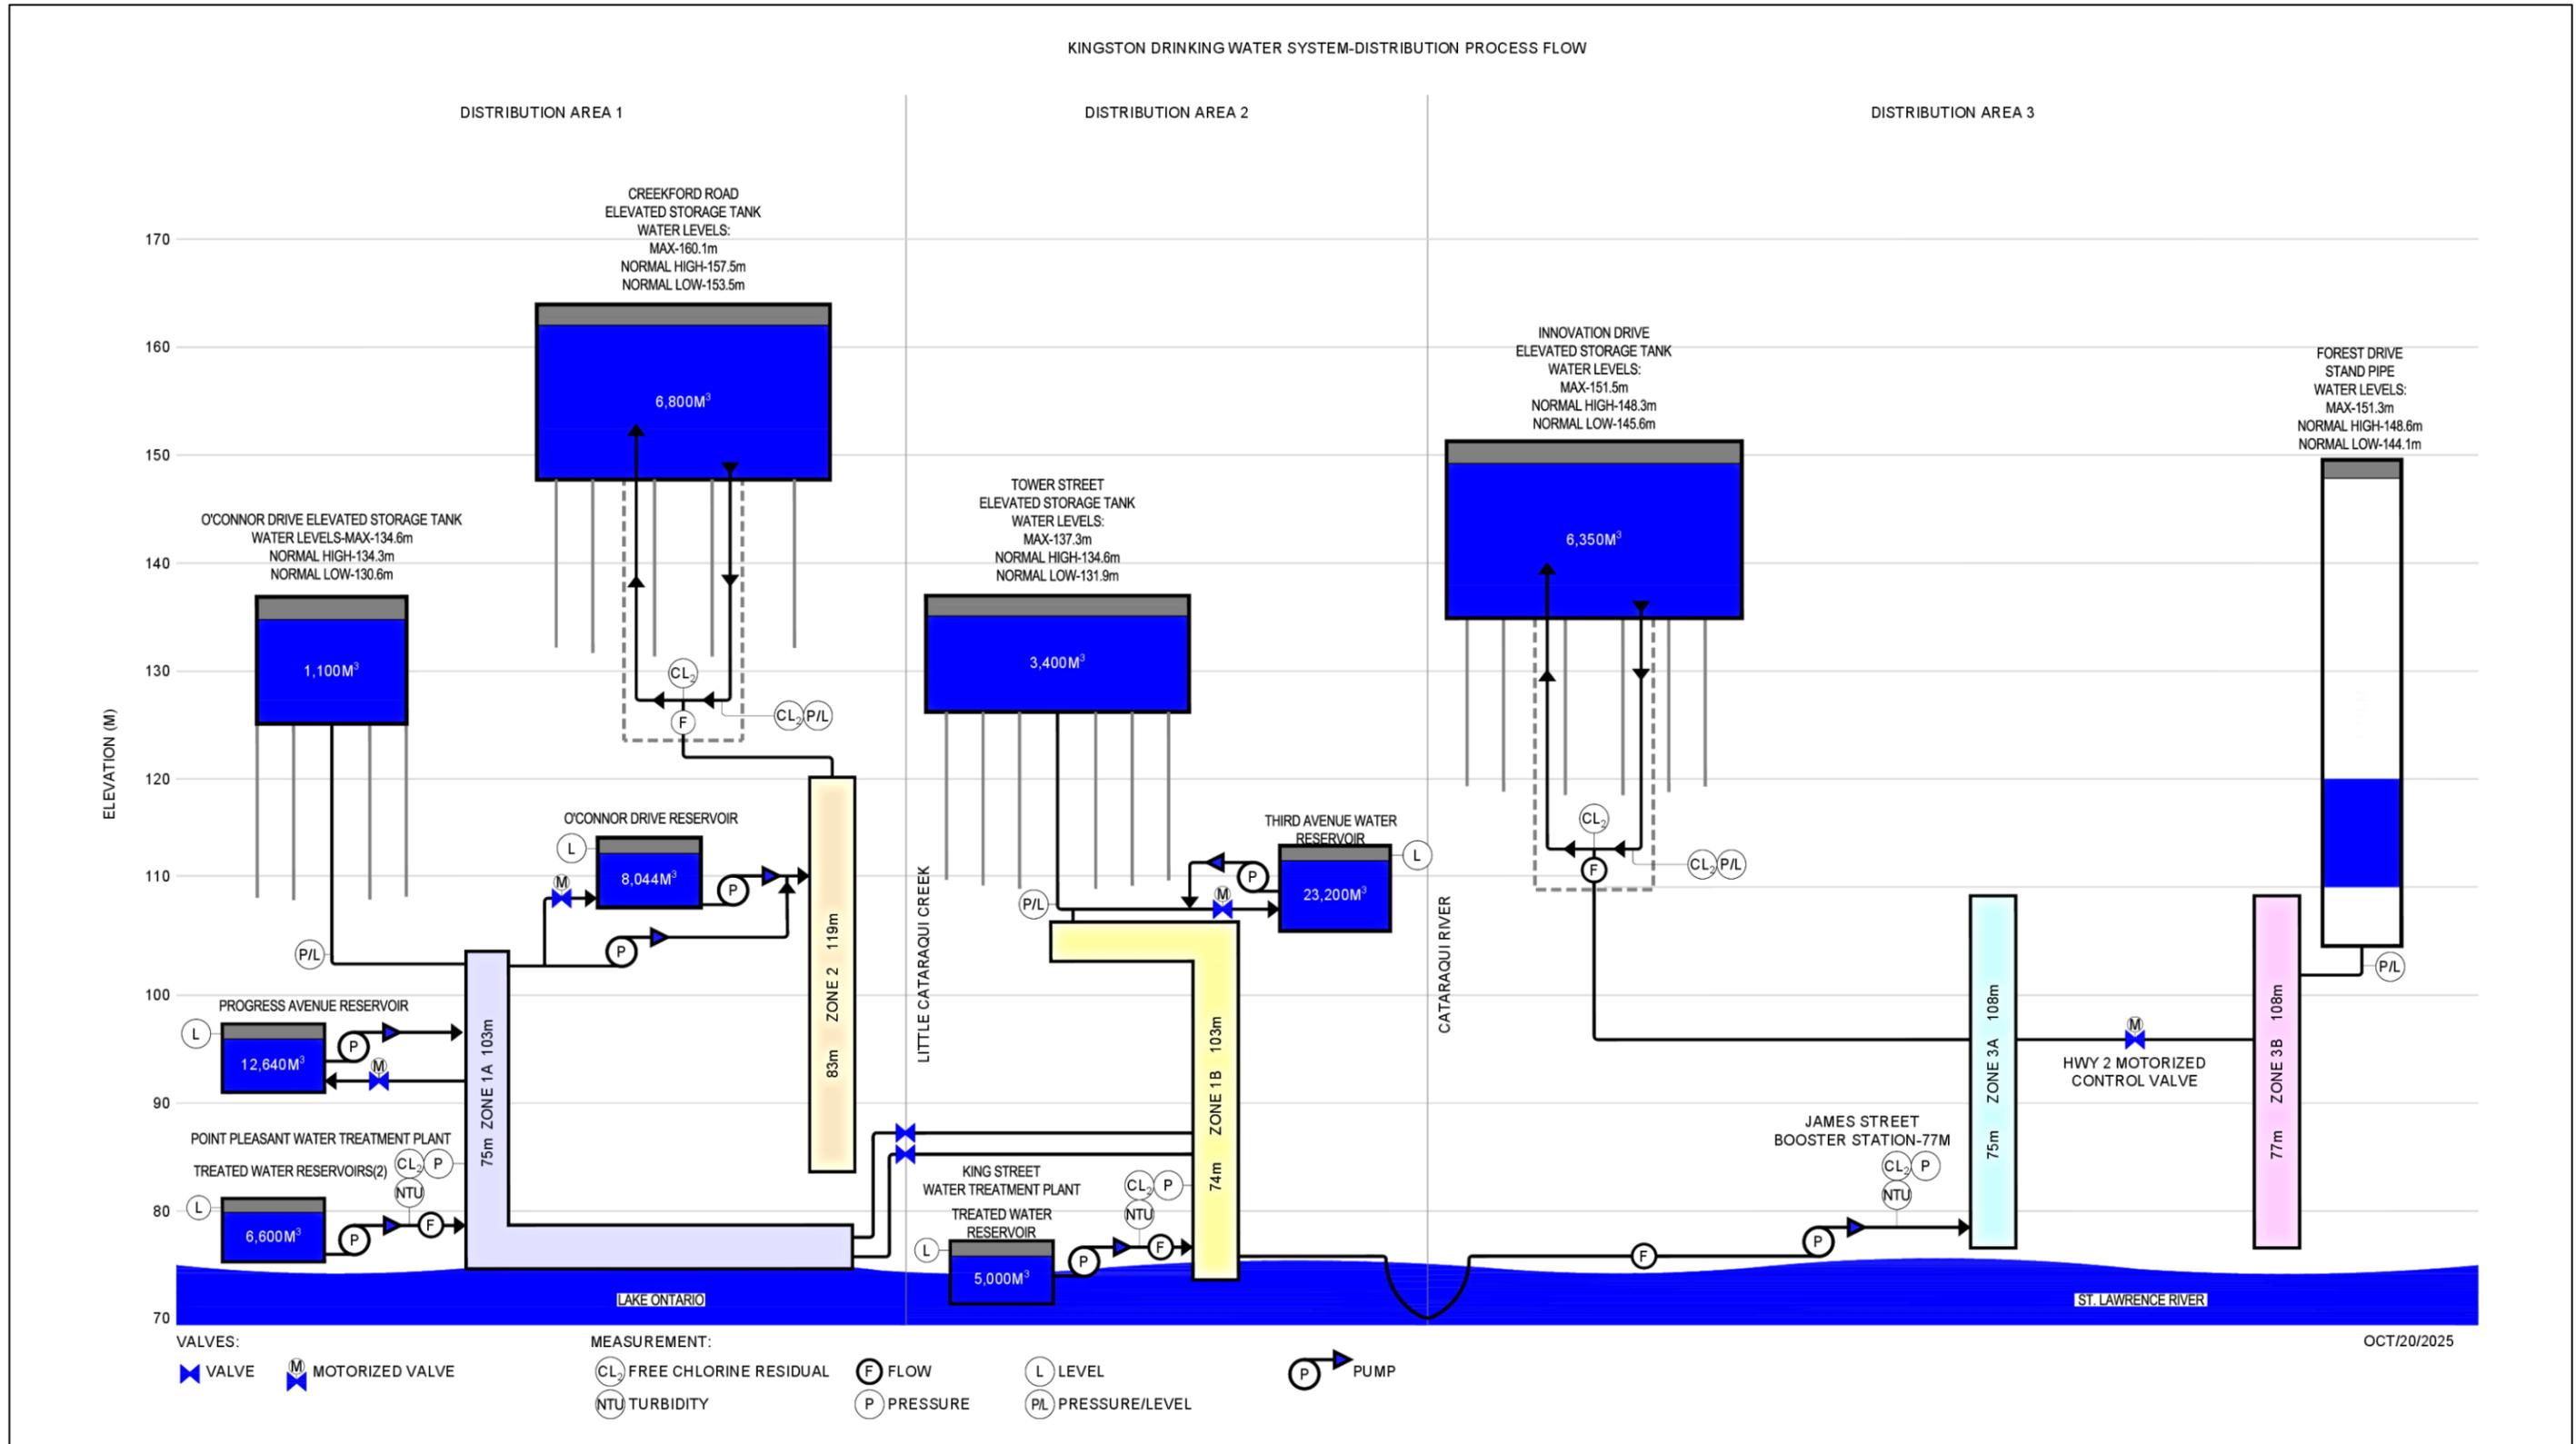

3 DISTRIBUTION SYSTEM

The Kingston Drinking Water System, which receives water from both the King Street Water Treatment Plant (WTP) and the Point Pleasant WTP, has a service population of approximately 132,485 (population from Census data for 2021). The distribution system is divided into three distribution areas.

3.1 DISTRIBUTION AREA 1

Distribution Area 1 is that area west of the Little Cataraqui Creek, south of Highway 401 and east of Coronation Boulevard, and north of Highway 401 along Sydenham Road northward to Mildred Street and eastward from Sydenham Road along Sunnyside Road for approximately 1.2 kilometers. Distribution Area 1 is comprised of approximately 220 km of water mains, 2 ground level reservoir/pumping stations, 2 elevated storage tanks, 4 booster stations, over 2,500 main line valves, and over 1,300 fire hydrants and their associated isolation valves.

Distribution Area 1 is divided into two distinct zones: Pressure Zone 1 and Pressure Zone 2.

Pressure Zone 1 is supplied by Point Pleasant WTP. This zone contains two storage facilities: O'Connor Drive Elevated Storage Tank and Progress Avenue Reservoir.

Pressure Zone 2 receives its water supply from Pressure Zone 1 via O'Connor Drive Reservoir and Booster Station. The Creekford Road Elevated Storage Tank is located within this zone.

3.2 DISTRIBUTION AREA 2

Distribution Area 2 is that area which is east of the Little Cataraqui Creek, west of the Cataraqui River, and south of Highway 401. A small area on the east side of the Cataraqui River upstream of the pumps at the James Street Booster Station is part of distribution Area 2. In addition, Collins Bay Institution, which is west of the Little Cataraqui Creek on Bath Road, is supplied with water from this area and from Area 1.

Distribution Area 2 is comprised of over 250km of water mains, 1 ground level reservoir/pumping station, 1 elevated storage tank, over 2,000 main line valves, and over 1,200 fire hydrants and their associated isolation valves. The King Street WTP provides water to Distribution Area 2. The Tower Street Elevated Storage Tank and the Third Avenue Reservoir are located within this distribution area.

3.3 DISTRIBUTION AREA 3

Distribution Area 3 is that area which is east of the Cataraqui River. Distribution Area 3 is comprised of over 70km of water mains, 1 water booster station, 2 elevated storage facilities, over 250 main line valves, and over 300 fire hydrants and their associated isolation valves.

Water is supplied to Distribution Area 3 from Distribution Area 2 through the James Street Booster Station. The Innovation Drive Elevated Storage Tank and the Forest Drive Standpipe are located within this pressure zone.

4 MONETARY EXPENSES

Under Section 11 of Ontario Regulation 170/03, a description of any major expenses incurred during this reporting period must be included in the annual report.

4.1 MAJOR EXPENSES:

- Ongoing water main replacement programs continued throughout the City of Kingston.

DOCUMENT:**King Street Water Treatment Plant Annual Report**

- Ongoing leak detection, hydrant maintenance, and valve operation programs were conducted throughout the distribution system.
- A PLC room temperature transmitter and highlight transceiver were installed.
- A Variable Frequency Drive (VFD) and SCADA control boards were installed for the low lift pumps.
- All filter actuators were replaced.
- One backwash sump pump was replaced; another was rebuilt.
- A high lift pressure transmitter was replaced.
- A process waste valve was replaced.
- Major repairs were completed due to a sewer system collapse at the facility.
- A comprehensive concrete assessment was completed on the facility.
- Security fencing was installed around the parking lot.
- A spill containment level switch was installed at the James Street Booster Station.
- The emergency lighting at Creekford Elevated Tank was replaced.
- A chlorine analyzer was purchased to be installed at the Third Avenue Reservoir.
- Safety eyewash chemicals (Diphoterine) were replaced at all facilities.
- Upgraded Davit arm, chain hoist and winch for the fall arrest equipment.
- Annual third-party analyzer and flow meter calibrations, and pump vibration analysis completed at all facilities.

5 NOTIFICATIONS

Under Ontario Regulation 170/03, notifications were required for any instances where a sample result indicated that a parameter used to measure water quality exceeded a Maximum Acceptable Concentration (MAC). Once a notification is received from a laboratory or an observation of any other incident of adverse water quality is made by operations personnel, corrective action as dictated by the regulations is initiated in an effort to confirm the initial result. If confirmed, further action may be recommended by the Medical Officer of Health. If not confirmed, sampling will typically return to the normal schedule, or depending on the parameter, Utilities Kingston may choose to increase the sampling frequency to monitor the parameter more closely for a period of time.

5.1 EVENTS REQUIRING NOTIFICATIONS:

- An adverse water quality incident notification was received from Caduceon Environmental Laboratories regarding a sample collected on **June 23rd, 2025**, which was determined to have a Total Coliform (TC) count of **2 cfu/100mL**. The free chlorine residual at the time of sampling was **1.72 mg/L**. Notifications were made to the Spills Action Centre and to the Environmental Health Division of the local Ministry of Health. Resamples were collected from the same location, upstream and downstream and sent to the lab for analysis. With the free chlorine residual present in the original sample and the subsequent re-samples not indicating any adverse conditions, a contaminated sample bottle or sampling error is suspected.
- An adverse water quality incident notification was received from Caduceon Environmental Laboratories regarding a sample collected on **July 8th, 2025**, which was determined to have a Total Coliform (TC) count of **3 cfu/100mL**. The free chlorine residual at the time of sampling was **1.61 mg/L**. Notifications were made to the Spills Action Centre and to the Environmental Health Division of the local Ministry of Health. Resamples were collected from the same location, upstream and downstream and sent to the lab for analysis. With the free chlorine residual present in the original sample and the subsequent re-samples not indicating any adverse conditions, a contaminated sample bottle or sampling error is suspected.

DOCUMENT:**King Street Water Treatment Plant Annual Report**

- An adverse water quality incident notification was received from Caduceon Environmental Laboratories regarding a sample collected on **July 28th, 2025**, which was determined to have a Total Coliform (TC) count of **123 cfu/100mL**. The free chlorine residual at the time of sampling was **1.05 mg/L**. Notifications were made to the Spills Action Centre and to the Environmental Health Division of the local Ministry of Health. Resamples were collected from the same location, upstream and downstream and sent to the lab for analysis. With the free chlorine residual present in the original sample and the subsequent re-samples not indicating any adverse conditions, a contaminated sample bottle or sampling error is suspected.

6 GLOSSARY

TCU – True Colour Units

mg – Milligram

N/A – Not Applicable

N/D – Non-Detectable

NTU – Nephelometric Turbidity Units - A measure of the amount of particles in water.

mg/L – Milligrams per litre. This is a measure of the concentration of a parameter in water, also called parts per million (ppm).

µg/L – Micrograms per litre, also called parts per billion.

ng/L – Nanograms per litre, also called parts per trillion.

Parameter – A substance that we sample and analyze for in the water.

AO – Aesthetic Objective. AOs are not health related, but may affect the taste, odour, colour, or clarity of the water

OG – Operational guideline. Set to ensure efficient treatment and distribution of water.

MAC – Maximum Acceptable Concentration. This is a health-related drinking water standard established for contaminants having known or suspected adverse health effects when above a certain concentration. The length of time the MAC can be exceeded without injury to health will depend on the nature and concentration of the parameter.

7 WATER QUALITY TEST RESULTS

Table 1 - Microbiological Testing

(Performed Under Regulation 170/03)

Location	MAC (E. Coli & Total Coliforms)	Number of Samples	Range of E. Coli Results (Min - Max)	Range of Total Coliform Results (Min - Max)	Number of HPC Samples	Range of HPC Results (Min - Max)
Raw	N/A	52	0 - 1	0 - 15	N/A	N/A
Treated	0	52	0	0	52	Under 10 - 290
Kingston Drinking Water System	0	1356	0	0 - 123	722	Under 10 - 860

Note: Total Coliforms are an indicator of adverse water quality if detected

Table 2 - Operational Testing

(Performed under Schedule 7, 8, or 9 of Regulation 170/03)

Parameter	MAC	Number of Samples	Range of Results (min - max)	Parameter Description
Raw Water Turbidity (NTU)	N/A	Continuous	0.065 - 4.85	Turbidity is a measure of particles in water
Treated Water Turbidity (NTU)	N/A	Continuous	0.023 - 0.165	Turbidity is a measure of particles in water
Treated Chlorine Residual (mg/L)	See Parameter Description	Continuous	0.90 - 3.06	Recommended level of at least 0.20 mg/l in distribution system to maintain microbiological quality. 0.05 mg/l minimum required.
James Street Booster Station Chlorine Residual (mg/L)	See Parameter Description	Continuous	1.18 - 3.0	Recommended level of at least 0.20 mg/l in distribution system to maintain microbiological quality. 0.05 mg/l minimum required.
Kingston Drinking Water System Chlorine Residual (mg/L)	See Parameter Description	Continuous	0.10 - 3.0	Recommended level of at least 0.20 mg/l in distribution system to maintain microbiological quality. 0.05 mg/l minimum required.

Note: Turbidity range determined through in house lab testing

Table 3 - Filter Operational Testing

Parameter	MAC	Number of Samples	Range of Results (min - max)	Results Average
Filter #1 Effluent Turbidity (NTU)	1.0 for over 15 minutes	Continuous	0.030 - 1.600	0.095
Filter #2 Effluent Turbidity (NTU)	1.0 for over 15 minutes	Continuous	0.040 - 0.358	0.079
Filter #3 Effluent Turbidity (NTU)	1.0 for over 15 minutes	Continuous	0.030 - 0.270	0.069
Filter #4 Effluent Turbidity (NTU)	1.0 for over 15 minutes	Continuous	0.040 - 2.000	0.080
Filter #5 Effluent Turbidity (NTU)	1.0 for over 15 minutes	Continuous	0.015 - 0.360	0.115
Filter #6 Effluent Turbidity (NTU)	1.0 for over 15 minutes	Continuous	0.014 - 0.660	0.118

Table 4 - Process Waste Facility Effluent Testing and Sampling

Parameter	MAC	Number of Samples	Results Average	Parameter Description
Total Suspended Solids (mg/L)	25	12	4.00	A measure of the particulates collected in the filtration process.
Chlorine Residual (mg/L)	Over 0.02	12	0.0125	Residual of 0 mg/L as required by the drinking water licence for this facility

Note: Testing and sampling in accordance with the requirements of the Municipal Drinking Water Licence

Table 5 - Additional Process Waste Facility Effluent Testing and Sampling

Parameter	MAC	Number of Samples	Results Average	Parameter Description
BOD5 (mg/L)	N/A	12	3	Biological Oxygen Demand
Aluminum (mg/L)	N/A	12	0.82	Residual from treatment process
pH	N/A	12	7.72	An indicator of the acidity of water

Table 6 - Raw Water Testing

(Analyzed by Accredited Laboratories)

Parameter	MAC	Number of Samples	Results Range (min - max)	MAC Exceedance (Yes or No)	Parameter Description
Alkalinity as CaCO ₃ (mg/L)	N/A	4	94 - 104	N/A	A measure of the resistance of the water to the effects of acids. Expressed as calcium carbonate.
Aluminum (mg/L)	N/A	2	0.02	N/A	May be naturally present.
Ammonia Nitrogen (mg/L)	N/A	2	Under 0.05 - 0.1	N/A	Occurs naturally from organic nitrogen containing compounds.
Antimony (mg/L)	N/A	0	N/A	N/A	Discharge from petroleum refineries; fire retardants; ceramics; electronics; solder
Arsenic (mg/L)	N/A	2	0.0007	N/A	Naturally occurring in surface waters / mine drainage
Barium (mg/L)	N/A	0	N/A	N/A	Erosion of natural deposits. Discharge from metal refineries, oil drilling wastes.
Boron (mg/L)	N/A	0	N/A	N/A	Erosion of natural deposits, industrial waste effluents.
Cadmium (mg/L)	N/A	0	N/A	N/A	Industrial discharge
Calcium (mg/L)	N/A	3	34.2 - 36.4	N/A	Naturally occurring.
Chloride (mg/L)	N/A	2	22.5 - 23.8	N/A	A common naturally occurring non-toxic material that may produce a salty taste in water.

UTILITIES KINGSTON – WATER TREATMENT – ANNUAL REPORT

DOCUMENT:
King Street Water Treatment Plant Annual Report

Parameter	MAC	Number of Samples	Results Range (min - max)	MAC Exceedance (Yes or No)	Parameter Description
Chromium (mg/L)	N/A	0	N/A	N/A	Industrial residues
Colour (TCU)	N/A	12	Under 2	N/A	Typically the result of organic matter in surface waters.
Conductivity (Us / cm)	N/A	2	307 - 310	N/A	A measure of ability of water to carry an electric current due to the presence of ions.
Copper (mg/L)	1 OG	2	Under 0.002	N/A	Domestic plumbing (Aesthetic objective)
Dissolved Organic Carbon (mg/L)	N/A	4	2.6 - 3.5	N/A	High DOC is an indicator of potential for chlorination by-product problems.
Fluoride (mg/L)	N/A	4	Under 0.1	N/A	Naturally occurring.
Hardness (mg/L)	N/A	4	123 - 126	N/A	Naturally occurring from dissolved calcium and magnesium.
Iron (mg/L)	N/A	2	Under 0.008 - 0.041	N/A	Leaching from natural deposits and plumbing materials, industrial wastes. (Aesthetic objective)
Lead (mg/L)	N/A	10	Under 0.00002 - 0.00018	N/A	Internal corrosion of household plumbing, erosion of natural deposits.
Manganese (mg/L)	N/A	2	Under 0.002 - 0.003	N/A	Erosion of natural deposits.
Microcystin (µg/L)	N/A	22	Under 0.15	N/A	Naturally occurring (released from blooms of blue-green algae)
Nitrate (mg/L)	N/A	4	0.20 - 0.33	N/A	Runoff from fertilizer use, erosion of natural deposits
Nitrite (mg/L)	N/A	4	Under 0.05	N/A	A natural component of water at this level.
Nitrioltriactic Acid (mg/L)	0.4	0	N/A	No	A human made organic compound
N-Nitrosodimethylamine (mg/L)	0.0009	0	N/A	No	An organic chemical often found as an industrial biproduct
pH	N/A	12	6.78 - 8.13	N/A	An indicator of the acidity of water.
Selenium (mg/L)	N/A	0	N/A	N/A	Discharge from refineries, mines, chemical manufacture
Sodium (mg/L)	20	4	13.1 - 14.4	No	Occurs naturally in the earth's crust.
Sulphate (mg/L)	N/A	4	Under 0.05 - 0.06	N/A	An inorganic constituent that may cause tastes at high levels.

DOCUMENT:
King Street Water Treatment Plant Annual Report

Parameter	MAC	Number of Samples	Results Range (min - max)	MAC Exceedance (Yes or No)	Parameter Description
Total Kjeldahl Nitrogen (mg/L)	N/A	4	N/A	N/A	Indicator of organic contamination or the potential for taste and odour problems.
Total Phenols (mg/L)	N/A	4	N/A	N/A	A chemical compound found in nature and used in a wide variety of products.
Uranium (mg/L)	N/A	0	7.23 - 8.10	N/A	Erosion of natural deposits.
Zinc (mg/L)	N/A	2	N/A	N/A	An inorganic constituent that may cause tastes.

Table 7 - Treated Water Schedule 23 Inorganic Parameters

Parameter	MAC	Number of Samples	Results Range (min - max)	MAC Exceedance (Yes or No)	Parameter Description
Antimony (mg/L)	0.006	2	0.0001	No	Discharge from petroleum refineries; fire retardants; ceramics; electronics; solder
Arsenic (mg/L)	0.025	2	0.0005	No	Naturally occurring in surface waters / mine drainage
Barium (mg/L)	1	2	0.022 - 0.025	No	Erosion of natural deposits. Discharge from metal refineries, oil drilling wastes.
Boron (mg/L)	5	2	0.020 - 0.022	No	Erosion of natural deposits, industrial waste effluents.
Cadmium (mg/L)	0.005	2	Under 0.000015	No	Industrial discharge
Chromium (mg/L)	0.05	2	Under 0.001	No	Industrial residues
Mercury (mg/L)	0.001	2	Under 0.00002	No	Erosion of natural deposits, industrial discharges.
Selenium (mg/L)	0.01	2	Under 0.001	No	Discharge from refineries, mines, chemical manufacture
Uranium (mg/L)	0.02	2	0.00008 - 0.00029	No	Erosion of natural deposits.

Table 8 - Treated Water Schedule 24 Inorganic Parameters

Parameter	MAC	Number of Samples	Results Range (min - max)	MAC Exceedance (Yes or No)	Parameter Description
Alachlor (µg/L)	5	2	Under 0.3	No	Agricultural herbicide
Atrazine + N-Dealkylated Metabolites (µg/L)	5	2	Under 0.5	No	Agricultural herbicide

UTILITIES KINGSTON – WATER TREATMENT – ANNUAL REPORT

DOCUMENT:
King Street Water Treatment Plant Annual Report

Parameter	MAC	Number of Samples	Results Range (min - max)	MAC Exceedance (Yes or No)	Parameter Description
Azinphosmethyl (µg/L)	20	0	N/A	No	Insecticide
Benzene (µg/L)	5	2	Under 0.5	No	Discharge from plastics manufacturing, leaking fuel tanks
Benzo(a)pyrene (µg/L)	0.01	2	Under 0.006	No	Formed from the incomplete burning of organic matter.
Bromoxynil (µg/L)	5	2	Under 0.5	No	Agricultural herbicide
Carbaryl (µg/L)	90	2	Under 3	No	Agricultural/Forestry/ Household insecticide
Carbofuran (µg/L)	90	2	Under 1	No	Agricultural insecticide
Carbon Tetrachloride (µg/L)	5	2	Under 0.2	No	Discharge from chemical and industrial activities
Chlorpyrifos (µg/L)	90	2	Under 0.5	No	Agricultural/ Household insecticide
Diazinon (µg/L)	20	2	Under 1	No	Agricultural/ Livestock Operation/ Residential insecticide
Dicamba (µg/L)	120	2	Under 1	No	Agricultural herbicide
1,2-Dichlorobenzene (µg/L)	200	2	Under 0.5	No	Discharge from industrial chemical factories
1,4-Dichlorobenzene (µg/L)	5	2	Under 0.5	No	Discharge from industrial chemical factories
1,2-Dichloroethane (µg/L)	5	2	Under 0.5	No	Discharge from industrial chemical factories
1,1-Dichloroethylene (µg/L)	14	2	Under 0.5	No	Discharge from industrial chemical factories
Dichloromethane (µg/L)	50	1	Under 5	No	Discharge from pharmaceutical and chemical factories
2,4-Dichlorophenol (µg/L)	900	2	Under 0.2	No	Industrial contamination/ reaction with chlorine
2,4-Dichlorophenoxy Acetic Acid (µg/L)	100	2	Under 1	No	Agricultural/ Residential herbicide
Diclofop-methyl (µg/L)	9	2	Under 0.9	No	Agricultural herbicide
Dimethoate (µg/L)	20	2	Under 1	No	Agricultural/ Livestock Operation/ Forestry insecticide
Diquat (µg/L)	70	2	Under 5	No	Agricultural/ Aquatic herbicide
Diuron (µg/L)	150	2	Under 5	No	Agricultural/ Industrial/ herbicide
Glyphosate (µg/L)	280	2	Under 25	No	Agricultural/Forestry/ Household herbicide
Malathion (µg/L)	190	2	Under 5	No	Fruit & Vegetable / pest control insecticide

DOCUMENT:
King Street Water Treatment Plant Annual Report

Parameter	MAC	Number of Samples	Results Range (min - max)	MAC Exceedance (Yes or No)	Parameter Description
2-methyl-4-chlorophenoxyacetic Acid (µg/L)	100	2	Under 10	No	Leaching and/or runoff from agricultural and other uses
Metolachlor (µg/L)	50	2	Under 3	No	Agricultural herbicide
Metribuzin (µg/L)	80	2	Under 3	No	Agricultural herbicide
Monochlorobenzene (µg/L)	80	2	Under 0.5	No	Discharge from industrial and agricultural chemical factories and dry cleaning facilities
Paraquat (µg/L)	10	2	Under 1	No	Agricultural/ Aquatic herbicide
Pentachlorophenol (µg/L)	60	2	Under 0.2	No	Pesticide/ wood preservative residue
Phorate (µg/L)	2	2	Under 0.3	No	Agricultural insecticide
Picloram (µg/L)	190	2	Under 5	No	Industrial herbicide
Polychlorinated Biphenyls (µg/L)	3	2	Under 0.05	No	Residue from various industrial uses
Prometryne (µg/L)	1	2	Under 0.1	No	Agricultural herbicide
Simazine (µg/L)	10	2	Under 0.5	No	Agricultural herbicide or its residue
Terbufos (µg/L)	1	2	Under 0.5	No	Agricultural insecticide
Tetrachloroethylene (µg/L)	30	2	Under 0.5	No	Leaching from PVC pipes; discharge from factories, dry cleaners and auto shops (metal degreaser)
2,3,4,6-Tetrachlorophenol (µg/L)	100	2	Under 0.2	No	Wood preservative
Triallate (µg/L)	230	2	Under 10	No	Agricultural herbicide
Trichloroethylene (µg/L)	5	2	Under 0.5	No	Discharge from metal degreasing sites and other factories
2,4,6-Trichlorophenol (µg/L)	5	2	Under 0.2	No	Pesticide manufacturing
Trifluralin (µg/L)	45	2	Under 0.5	No	Agricultural herbicide
Vinyl Chloride (µg/L)	2	2	Under 0.2	No	Leaching from PVC pipes; discharge from plastics factories

Table 9 - Other Regulatory Treated Water Parameters

Parameter	MAC	Number of Samples	Results Range (min - max)	MAC Exceedance (Yes or No)	Parameter Description
Fluoride (mg/L)	1.5	4	Under 0.1	No	Naturally occurring.
Nitrite (mg/L)	1	12	Under 0.05-0.10	No	A natural component of water at this level.
Nitrate (mg/L)	10	12	0.17 - 0.35	No	Runoff from fertilizer use, erosion of natural deposits
Sodium (mg/L)	20	2	16.8 - 18.4	No	Occurs naturally in the earth's crust. Notification is required every 60 months if greater than 20 mg/L

Table 10 - Treated Water Testing

(Analyzed by Accredited Laboratories)

Parameter	MAC	Number of Samples	Results Range (min - max)	MAC Exceedance (Yes or No)	Parameter Description
Alkalinity CaCO ₃ (mg/L)	N/A	4	94 - 106	N/A	Discharge from petroleum refineries; fire retardants; ceramics; electronics; solder
Aluminum (mg/L)	0.1 OG	12	0.05 - 0.13	N/A	Naturally occurring in surface waters / mine drainage
Ammonia Nitrogen (mg/L)	N/A	4	Under 0.05 - 0.08	N/A	Erosion of natural deposits. Discharge from metal refineries, oil drilling wastes.
Calcium (mg/L)	N/A	4	34.1 - 36.6	N/A	Erosion of natural deposits, industrial waste effluents.
Chloride (mg/L)	250	4	26.7 - 28.0	No	Industrial discharge
Colour (TCU)	5	12	Under 2	No	Industrial residues
Conductivity (Us/cm)	N/A	4	317 - 329	N/A	Erosion of natural deposits, industrial discharges.
Cyanide (mg/L)	0.2	0	N/A	N/A	Discharge from refineries, mines, chemical manufacture
Dissolved Organic Carbon (mg/L)	N/A	4	1.9 - 3.0	N/A	Erosion of natural deposits.
Gross Alpha (bq/L)	0.5	0	N/A	No	Measure of radioactivity
Gross Beta (bq/L)	1	0	N/A	No	Measure of radioactivity
Total Haloacetic acids (mg/L)	0.08 (Annual Average)	12	0.0053 - 0.0157	No	By-product of drinking water disinfection with chlorine. Based on a running annual average
Hardness (mg/L)	100 OG	4	124 - 126	N/A	Naturally occurring from dissolved calcium and magnesium.
Iron (mg/L)	0.3 AO	4	Under 0.005	N/A	Leaching from natural deposits and plumbing materials, industrial wastes. (Aesthetic objective)
Lead (mg/L)	0.01	10	Under 0.00002 - 0.00019	No	Internal corrosion of household plumbing, erosion of natural deposits.
Manganese (mg/L)	0.05 AO	4	Under 0.001	N/A	Erosion of natural deposits.
Microcystin (µg/L)	1.5	0	N/A	No	Naturally occurring (released from blooms of blue-green algae)

Parameter	MAC	Number of Samples	Results Range (min - max)	MAC Exceedance (Yes or No)	Parameter Description
Nitrilotriacetic acid/NTA (mg/L)	N/A	0	N/A	N/A	A human made organic compound
N-Nitrosodimethylamine (µg/L)	N/A	0	N/A	N/A	An organic chemical often found as an industrial biproduct
pH	N/A	12	7.87 - 8.16	N/A	An indicator of the acidity of water.
Sulphate (mg/L)	500 OG	4	20 - 23	N/A	An inorganic constituent that may cause tastes at high levels.
Total Trihalomethanes (µg/L)	100 (Annual avg.)	13	9 - 37	No	By-product of chlorination. * The MAC for THMs of 100 µg/L is based on a running annual average.
Total Kjeldahl Nitrogen (mg/L)	N/A	4	Under 0.1 - 0.2	N/A	Indicator of organic contamination or the potential for taste and odour problems.
Tritium (bg/L)	N/A	0	N/A	N/A	A form of hydrogen
Zinc (mg/L)	5	4	Under 0.005	No	An inorganic constituent that may cause tastes.

Table 11 - Regulatory Distribution Water Testing

Parameter	MAC	Number of Samples	Results Range (min - max)	MAC Exceedance (Yes or No)	Parameter Description
Total Haloacetic Acids (mg/L)	0.08 (Annual avg.)	12	0.0053 - 0.0406	No	By-product of drinking water disinfection with chlorine. Based on a running annual average
Total Trihalomethanes (µg/L)	100 (Annual avg.)	21	9.0 - 89.0	No	By-product of chlorination. * The MAC for THMs of 100 µg/L is based on a running annual average.

Table 12 - Lead Testing

(Under Schedule 15.1 of Regulation 170/03)

Parameter	MAC mg/L	Number of Sample Locations	Results Exceeding 0.01 mg/L	Results Range mg/L (min - max)	pH Range (min - max)	Alkalinity (CaCO ₃) Range mg/L (min - max)
Residential	0.01	23	0	0.00002 - 0.00988	7.1 - 8.15	N/A
Non-Residential	0.01	9	0	0.00002 - 0.00132	7.10 - 7.98	91 - 103

Table 13 - Distribution Water Testing

(Analyzed by Accredited Laboratories)

Parameter	MAC	Number of Samples	Results Range (min - max)	MAC Exceedance (Yes or No)	Parameter Description
Alkalinity CaCO ₃ (mg/L)	N/A	17	91 - 103	N/A	A measure of the resistance of the water to the effects of acids. Expressed as calcium carbonate.
Aluminum (mg/L)	0.1 OG	8	0.04 - 0.12	N/A	May be naturally present or a residual from the coagulation process.
Ammonia Nitrogen (mg/L)	N/A	8	Under 0.05 - 0.06	N/A	Occurs naturally from organic nitrogen containing compounds.
Arsenic (mg/L)	0.025	2	0.0004 - 0.0005	No	Naturally occurring in surface waters / mine drainage
Benzo(a)-pyrene (µg/L)	N/A	0	N/A	N/A	Formed during the combustion of organic matter
Calcium (mg/L)	N/A	8	32.6 - 37.5	N/A	Naturally occurring.
Chloride (mg/L)	250	8	26.6 - 27.7	No	A common naturally occurring non-toxic material that may produce a salty taste in water.
Colour (TCU)	5	2	Under 2	No	Typically the result of organic matter in surface waters.
Conductivity (Us/cm)	N/A	8	312 - 323	N/A	A measure of ability of water to carry an electric current due to the presence of ions.
Copper (mg/L)	1 OG	8	0.0005 - 0.0031	N/A	Domestic plumbing (Aesthetic objective)
Cyanide (mg/L)	0.2	0	N/A	N/A	Compound used in a variety of industrial processes
Dissolved Organic Carbon (mg/L)	5 AO	8	1.3 - 3.1	N/A	High DOC is an indicator of potential for chlorination by-product problems.
Fluoride (mg/L)	1.5	2	Under 0.1	No	Naturally occurring.
Gross Alpha (bg/L)	0.5	0	N/A	N/A	Measure of radioactivity
Gross Beta (bg/L)	1	0	N/A	N/A	Measure of radioactivity
Hardness (mg/L)	100 OG	8	119 - 128	N/A	Naturally occurring from dissolved calcium and magnesium.

DOCUMENT:
King Street Water Treatment Plant Annual Report

Parameter	MAC	Number of Samples	Results Range (min - max)	MAC Exceedance (Yes or No)	Parameter Description
Iron (mg/L)	0.3 AO	8	Under 0.005 - 0.006	N/A	Leaching from natural deposits and plumbing materials, industrial wastes. (Aesthetic objective)
Manganese (mg/L)	0.05 AO	8	Under 0.001 - 0.001	N/A	Erosion of natural deposits.
Nitrite (mg/L)	1	2	Under 0.05	No	A natural component of water at this level.
Nitrate (mg/L)	10	2	0.27 - 0.28	No	Runoff from fertilizer use, erosion of natural deposits
Nitrioltriacetic Acid (mg/L)	0.4	0	N/A	N/A	A human made organic compound
Nitrosodimethylamine (µg/l)	0.0009	0	N/A	N/A	An organic chemical often found as an industrial biproduct
pH	6.5–8.5 OG	8	7.49 - 8.11	N/A	An indicator of the acidity of water.
Sodium (mg/L)	20	8	14.4 - 17.4	No	Occurs naturally in the earth's crust.
Sulphate (mg/L)	500 OG	8	18 - 23	N/A	An inorganic constituent that may cause tastes at high levels.
Total Kjeldahl Nitrogen (mg/L)	N/A	8	Under 0.1 - 0.2	N/A	Indicator of organic contamination or the potential for taste and odour problems.
Tritium (bg/L)	7000	0	N/A	No	A form of hydrogen
Zinc (mg/L)	5	8	Under 0.005 - 0.045	No	An inorganic constituent that may cause tastes.

Table 14 - Raw Water Testing

(Analyzed by In House Laboratory)

Parameter	MAC	Number of Samples	Average Results	MAC Exceedance (Yes or No)	Parameter Description
Alkalinity (mg/L)	N/A	37	95.8	N/A	A measure of the resistance of the water to the effects of acids. Expressed as calcium carbonate.
Hardness (mg/L)	N/A	36	112.5	N/A	Naturally occurring from dissolved calcium and magnesium.
pH	N/A	365	7.56	N/A	An indicator of the acidity of water
Temperature (°C)	N/A	365	12.97	N/A	Intensity of heat present in a substance or object

Table 15 - Treated Water Testing

(Analyzed by In House Laboratory)

Parameter	MAC	Number of Samples	Average Results	MAC Exceedance (Yes or No)	Parameter Description
Alkalinity (mg/L)	N/A	38	93	N/A	A measure of the resistance of the water to the effects of acids. Expressed as calcium carbonate.
Aluminum (mg/L)	0.1 OG	333	0.06	N/A	May be naturally present or a residual from the coagulation process.
Hardness (mg/L)	100 OG	36	113.9	N/A	Naturally occurring from dissolved calcium and magnesium.
pH	6.5 - 8.5 OG	365	7.51	N/A	An indicator of the acidity of water.
Temperature (Degrees Celsius)	N/A	365	10.59	N/A	Intensity of heat present in a substance or object